Murrough Landon
9 July 2001

USA15 Niveau 2

Plan view of racks. Those provisionally allocated to the level 1 trigger (calorimeter, muons, CTP etc) are shown in colour.

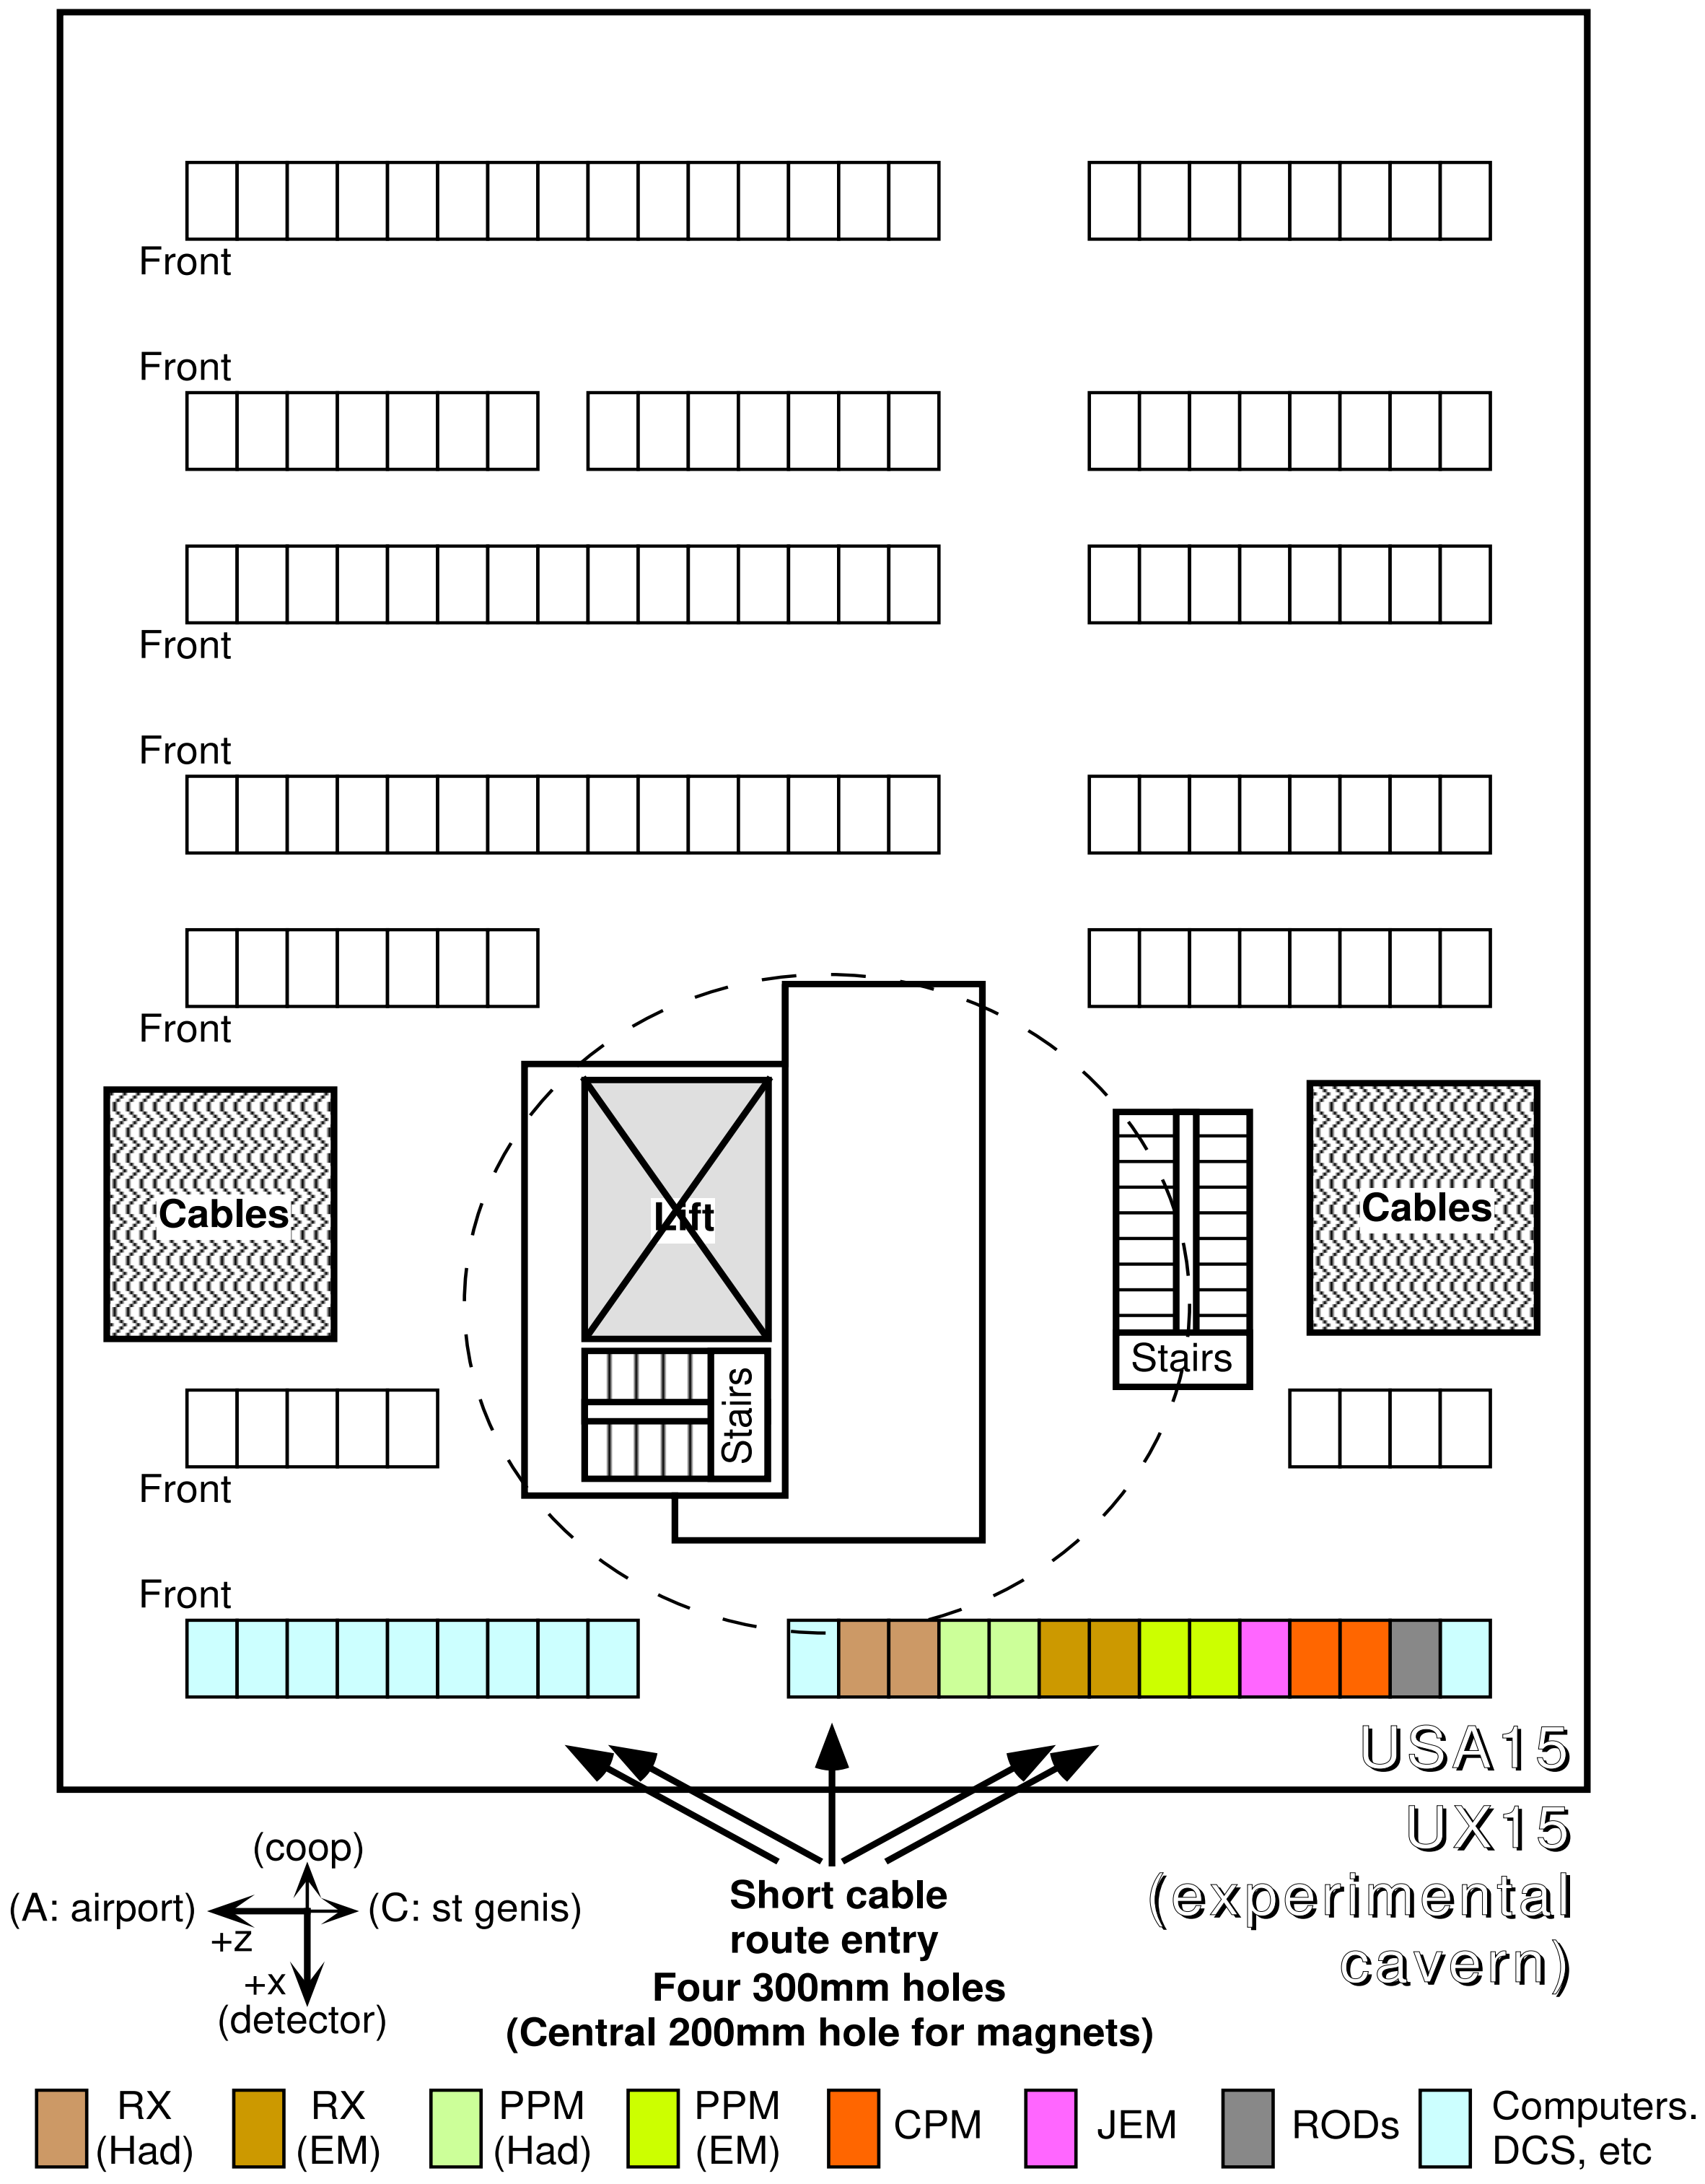

Murrough Landon
9 July 2001

USA15 Niveau 1

Plan view of racks. Those provisionally allocated to the level 1 trigger (calorimeter, muons, CTP etc) are shown in colour.